


# FSIS Raw Ground Beef Testing (All Sources)

## Percent Positive *Escherichia coli* O157:H7

### Quarterly CY2003 – CY2008\* (Figure 2)

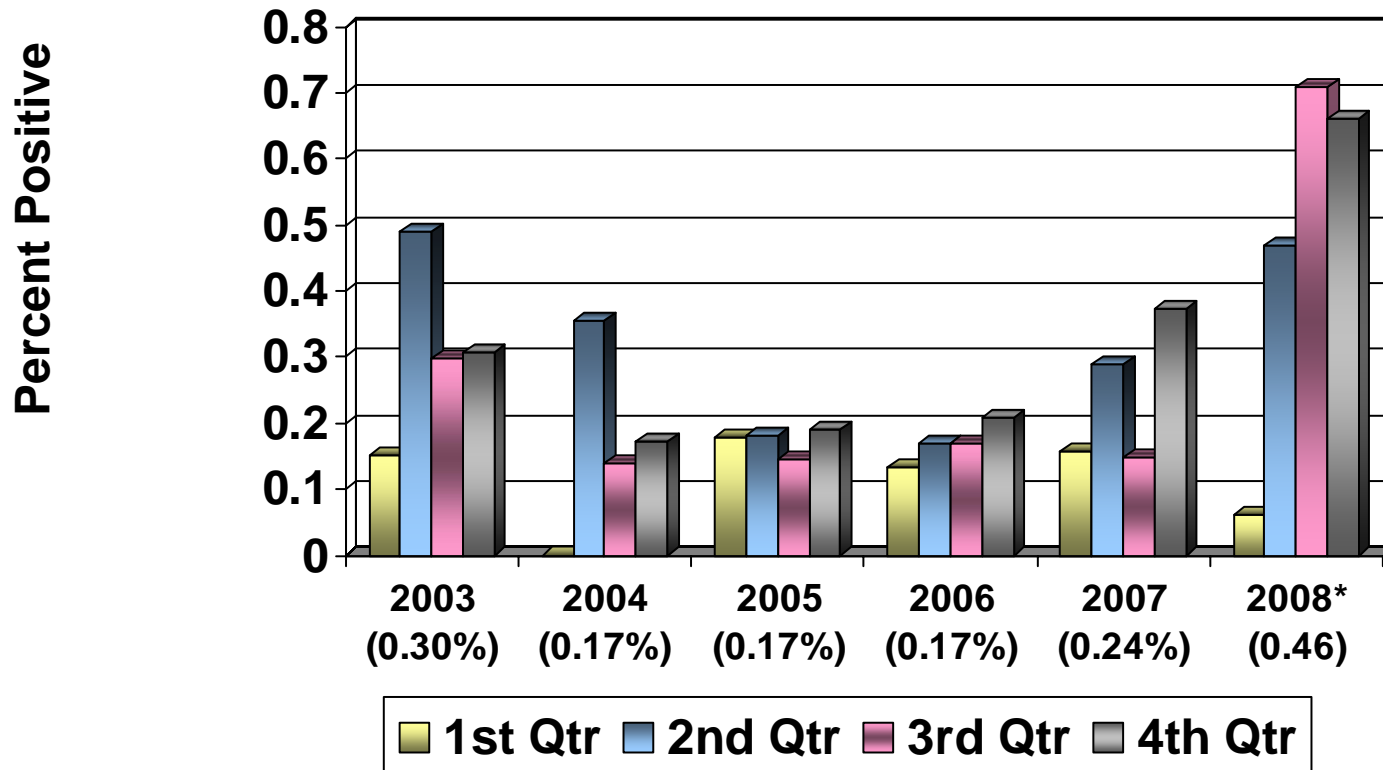

\*Starting with CY2008, annual microbiological results are reported by sample collection date as opposed to analysis end date.